
## 5.3.4 **B30_TW100_CP** - combustible pipes on timber wall ≥ 100 mm - TECNOBOARD

### Description

- Timber wall - thickness ≥ 100 mm.
- Fire-side sealing with TECNOBOARD and TECNOCOLLAR on both sides.
- The TECNOBOARD panel must be fixed to the outside of the support overlapping it by 100 mm with 300 mm pitch screws.

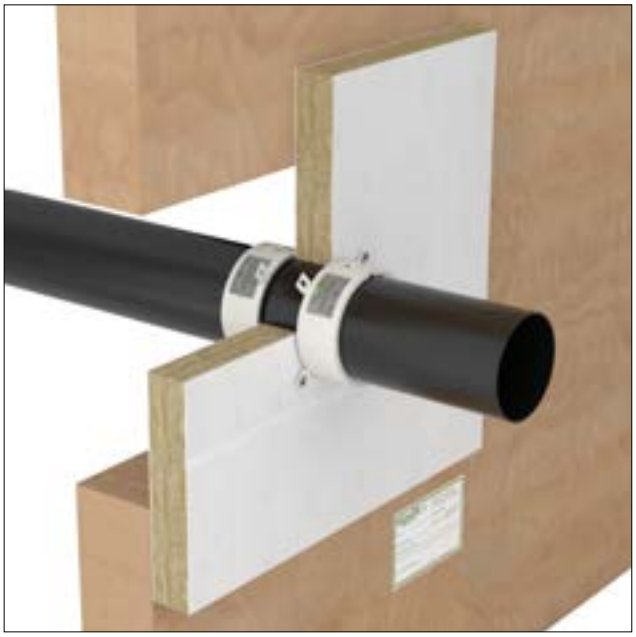

### Classification and field of application

| Type of pipe | Diameter [mm] | Max. aperture [mm] | Classification |
|---|---|---|---|
| PVC | 32 - 50 | 1200x600 | EI 60 (U/C) |
| | 55-160 | 1200x600 | EI 60 (C/C) |
| PE | 32 - 50 | 1200x600 | EI 60 U/C) |
| | 55 - 160 | 1200x600 | EI 60 (C/C) |
| PP | 32 - 160 | 1200x600 | EI 60 (C/C) |