
5.1.21 **T18_TW100_E** - electrical services on timber wall ≥ 100 mm - TECNOCOLLAR

Description

- Timber wall - thickness ≥ 100 mm.
- Fixing:
  A. On wooden wall: with wood/plasterboard screws ≥ Ø 4 mm.
- TECNOCOLLAR is installed on both sides.
- If cold smoke sealing is required, insert a spacer of stone wool between the cables and the support.

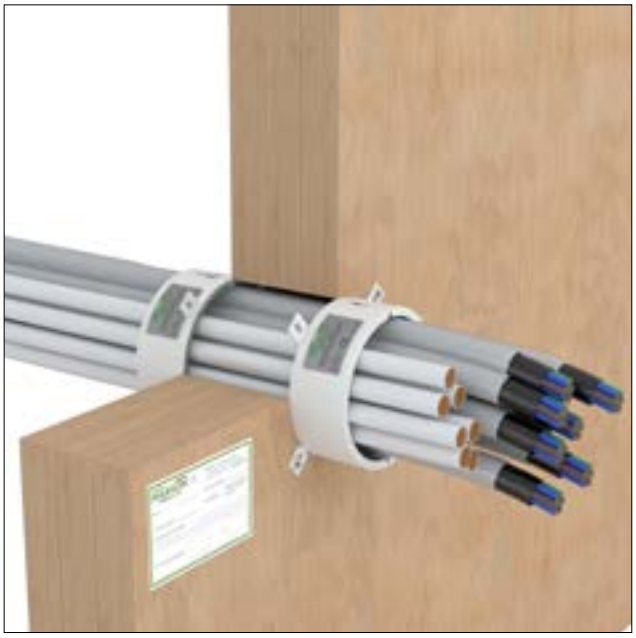

Classification and field of application

Type of electrical service	Diameter [mm]	Classification
Single or bundled electrical cables	Cable ≤ 80 Bundle ≤ 160	EI 60
Cable conduit bundle ≤ 40 mm (PVC-PE-PP)	Cable ≤ 21 Bundle ≤ 160	EI 90 (U/C)